

CULTEC RECHARGER® 360HD PRODUCT SPECIFICATIONS

- GENERAL**
- CULTEC RECHARGER® 360HD CHAMBERS ARE DESIGNED FOR UNDERGROUND STORMWATER MANAGEMENT. THE CHAMBERS MAY BE USED FOR RETENTION, RECHARGING, DETENTION OR CONTROLLING THE FLOW OF ON-SITE STORMWATER RUNOFF.
- CHAMBER PARAMETERS**
- THE CHAMBERS SHALL BE MANUFACTURED IN THE U.S.A. BY CULTEC, OF BROOKFIELD, CT (CULTEC.COM, 203-775-4416).
 - THE CHAMBERS SHALL BE DESIGNED AND TESTED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". THE LOAD CONFIGURATION SHALL INCLUDE:
 - INSTANTANEOUS AASHTO DESIGN TRUCK LIVE LOAD AT MINIMUM COVER
 - MAXIMUM PERMANENT (50-YEAR) COVER LOAD
 - 1-WEEK PARKED AASHTO DESIGN TRUCK LOAD
 - THE CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F3430-20 "STANDARD SPECIFICATION FOR CELLULAR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - THE INSTALLED CHAMBER SYSTEM SHALL PROVIDE RESISTANCE TO THE LOADS AND LOAD FACTORS AS DEFINED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS SECTION 12.12. WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS, THE STRUCTURAL DESIGN OF THE CHAMBERS SHALL INCLUDE THE FOLLOWING:
 - THE CREEP MODULUS SHALL BE 50-YEAR AS SPECIFIED IN ASTM F3430
 - THE MINIMUM SAFETY FACTOR FOR LIVE LOADS SHALL BE 1.75
 - THE MINIMUM SAFETY FACTOR FOR DEAD LOADS SHALL BE 1.95
 - THE INSTALLED CHAMBER SYSTEM SHALL BE STRUCTURALLY DESIGNED TO PROVIDE RESISTANCE TO LIVE LOADS AS DEFINED BY THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS SECTION 12.12. WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.
 - THE CHAMBER SHALL BE STRUCTURAL FOAM INJECTION MOLDED OF BLUE VIRGIN HIGH MOLECULAR WEIGHT IMPACT-MODIFIED POLYPROPYLENE.
 - THE CHAMBER SHALL BE ARCHED IN SHAPE.
 - THE CHAMBER SHALL BE OPEN-BOTTOMED.
 - THE CHAMBER SHALL BE JOINED USING AN INTERLOCKING OVERLAPPING RIB METHOD. CONNECTIONS MUST BE FULLY SHOULDERED OVERLAPPING RIBS, HAVING NO SEPARATE COUPLINGS.
 - THE NOMINAL CHAMBER DIMENSIONS OF THE CULTEC RECHARGER® 360HD SHALL BE 36 INCHES (914 MM) TALL, 60 INCHES (1525 MM) WIDE AND 50 INCHES (1275 MM) LONG. THE INSTALLED LENGTH OF A JOINED RECHARGER 360HD SHALL BE 3.67 FEET (1.12 M).
 - MULTIPLE CHAMBERS MAY BE CONNECTED TO FORM DIFFERENT LENGTH ROWS. EACH ROW SHALL BEGIN AND END WITH A SEPARATELY FORMED CULTEC RECHARGER® 360HD END CAP. MAXIMUM INLET OPENING ON THE END CAP IS 24 INCHES (600 MM) HDPE OR 30 INCHES (750 MM) PVC.
 - THE CHAMBER SHALL HAVE TWO SIDE PORTALS TO ACCEPT CULTEC HVLV™ FC-48 FEED CONNECTORS TO CREATE AN INTERNAL MANIFOLD. MAXIMUM ALLOWABLE PIPE SIZE IN THE SIDE PORTAL IS 10 INCHES (250 MM) HDPE AND 12 INCHES (300 MM) PVC.
 - THE NOMINAL CHAMBER DIMENSIONS OF THE CULTEC HVLV™ FC-48 FEED CONNECTOR SHALL BE 12 INCHES (305 MM) TALL, 16 INCHES (406 MM) WIDE AND 49 INCHES (1245 MM) LONG.
 - THE NOMINAL STORAGE VOLUME OF THE RECHARGER 360HD CHAMBER SHALL BE 10.0 FT³ / UNIT (0.28 M³ / UNIT) - WITHOUT STONE.
 - THE NOMINAL STORAGE VOLUME OF THE HVLV™ FC-48 FEED CONNECTOR SHALL BE 0.913 FT³ / UNIT (0.085 M³ / UNIT) - WITHOUT STONE.
 - THE RECHARGER 360HD CHAMBER SHALL HAVE 7 CORRUGATIONS.
 - THE CHAMBER SHALL BE CAPABLE OF ACCEPTING A 6 INCH (150 MM) INSPECTION PORT OPENING AT THE TOP CENTER OF EACH CHAMBER, CENTERED ON THE CORRUGATION CREST.
 - THE UNITS MAY BE TRIMMED TO CUSTOM LENGTHS BY CUTTING BACK TO ANY CORRUGATION.
 - THE CHAMBER SHALL BE MANUFACTURED IN A FACILITY EMPLOYING CULTEC'S QUALITY CONTROL AND ASSURANCE PROCEDURES.
 - MAXIMUM ALLOWABLE COVER OVER THE TOP OF THE CHAMBER SHALL BE 12.0 FEET (3.66 M).

- END CAP PARAMETERS**
- THE CULTEC RECHARGER® 360HD END CAP (REFERRED TO AS "END CAP") SHALL BE MANUFACTURED IN THE U.S.A. BY CULTEC, OF BROOKFIELD, CT (CULTEC.COM, 203-775-4416).
 - THE END CAP SHALL BE STRUCTURAL FOAM INJECTION MOLDED OF BLUE VIRGIN HIGH MOLECULAR WEIGHT IMPACT-MODIFIED POLYPROPYLENE.
 - THE END CAP SHALL BE ARCHED IN SHAPE.
 - THE END CAP SHALL BE JOINED AT THE BEGINNING AND END OF EACH ROW OF CHAMBERS USING AN INTERLOCKING OVERLAPPING RIB METHOD. CONNECTIONS MUST BE FULLY SHOULDERED OVERLAPPING RIBS, HAVING NO SEPARATE COUPLINGS.
 - THE END CAP SHALL HAVE 5 CORRUGATIONS.
 - THE NOMINAL DIMENSIONS OF THE END CAP SHALL BE 36.5 INCHES (927 MM) TALL, 60 INCHES (1525 MM) WIDE AND 18 INCHES (457 MM) LONG. WHEN JOINED WITH A RECHARGER 360HD CHAMBER, THE INSTALLED LENGTH OF THE END CAP SHALL BE 15 INCHES (381 MM).
 - THE NOMINAL STORAGE VOLUME OF THE END CAP SHALL BE 5.17 FT³ / UNIT (0.48 M³ / UNIT) - WITHOUT STONE. THE NOMINAL STORAGE VOLUME OF AN INTERLOCKED END CAP SHALL BE 6.46 FT³ / UNIT (0.183 M³ / UNIT) - WITHOUT STONE.
 - MAXIMUM INLET OPENING ON THE END CAP IS 24 INCHES (600 MM) HDPE OR 30 INCHES (750 MM) PVC.
 - THE END CAP SHALL PROVIDE RESISTANCE TO THE LOADS AND LOAD FACTORS AS DEFINED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS SECTION 12.12.

CULTEC HVLV FC-48 FEED CONNECTOR PRODUCT SPECIFICATIONS


- GENERAL**
- CULTEC HVLV FC-48 FEED CONNECTORS ARE DESIGNED TO CREATE AN INTERNAL MANIFOLD FOR CULTEC RECHARGER MODEL 360HD STORMWATER CHAMBERS.
- FEED CONNECTOR PARAMETERS**
- THE FEED CONNECTOR SHALL BE MANUFACTURED BY CULTEC, OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
 - THE FEED CONNECTOR SHALL BE VACUUM THERMOFORMED OF HIGH MOLECULAR WEIGHT HIGH DENSITY POLYETHYLENE (HDPE) WITH A BLACK INTERIOR AND BLUE EXTERIOR.
 - THE FEED CONNECTOR SHALL BE ARCHED IN SHAPE.
 - THE FEED CONNECTOR SHALL BE OPEN-BOTTOMED.
 - THE NOMINAL DIMENSIONS OF THE CULTEC HVLV FC-48 FEED CONNECTOR SHALL BE 12 INCHES (305 mm) TALL, 16 INCHES (406 mm) WIDE AND 49 INCHES (1245 mm) LONG.
 - THE NOMINAL STORAGE VOLUME OF THE HVLV FC-48 FEED CONNECTOR SHALL BE 0.913 FT³ / UNIT (0.085 m³ / UNIT) - WITHOUT STONE.
 - THE HVLV FC-48 FEED CONNECTOR SHALL HAVE 4 CORRUGATIONS.
 - THE HVLV FC-48 FEED CONNECTOR MUST BE FORMED AS A WHOLE UNIT HAVING TWO OPEN END WALLS AND HAVING NO SEPARATE END PLATES OR SEPARATE END WALLS. THE UNIT SHALL FIT INTO THE SIDE PORTALS OF THE CULTEC RECHARGER STORMWATER CHAMBER AND ACT AS CROSS FEED CONNECTIONS CREATING AN INTERNAL MANIFOLD.
 - THE FEED CONNECTOR SHALL BE DESIGNED TO WITHSTAND AASHTO HS-25 DEFINED LOADS WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.
 - THE FEED CONNECTOR SHALL BE MANUFACTURED IN AN ISO 9001:2008 CERTIFIED FACILITY.
- CULTEC NO. 410™ NON-WOVEN GEOTEXTILE**
- CULTEC NO. 410™ NON-WOVEN GEOTEXTILE MAY BE USED WITH CULTEC CONTACTOR® AND RECHARGER® STORMWATER INSTALLATIONS TO PROVIDE A BARRIER THAT PREVENTS SOIL INTRUSION INTO THE STONE.
- GEOTEXTILE PARAMETERS**
- THE GEOTEXTILE SHALL BE PROVIDED BY CULTEC, OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
 - THE GEOTEXTILE SHALL BE BLACK IN APPEARANCE.
 - THE GEOTEXTILE SHALL HAVE A TYPICAL WEIGHT OF 4.5 OZ/SY (142 G/M).
 - THE GEOTEXTILE SHALL HAVE A TENSILE STRENGTH VALUE OF 120 LBS (533 N) PER ASTM D4632 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE AN ELONGATION @ BREAK VALUE OF 50% PER ASTM D4632 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A MULLEN BURST VALUE OF 225 PSI (1551 KPA) PER ASTM D3786 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A PUNCTURE STRENGTH VALUE OF 65 LBS (289 N) PER ASTM D4833 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A CBR PUNCTURE VALUE OF 340 LBS (1513 N) PER ASTM D6241 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A TRAPEZOIDAL TEAR VALUE OF 50 LBS (222 N) PER ASTM D4533 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A AOS VALUE OF 70 U.S. SIEVE (0.212 MM) PER ASTM D4751 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A PERMITTIVITY VALUE OF 1.7 SEC-1 PER ASTM D4491 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A WATER FLOW RATE VALUE OF 135 GAL/MIN/SF (5500 L/MIN/SM) PER ASTM D4491 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A UV STABILITY @ 500 HOURS VALUE OF 70% PER ASTM D4355 TESTING METHOD.
- CULTEC AFAB-HPF™ WOVEN GEOTEXTILE**
- CULTEC AFAB-HPF™ WOVEN GEOTEXTILE IS DESIGNED AS A UNDERLAYMENT TO PREVENT SCOURING CAUSED BY WATER MOVEMENT WITHIN THE CULTEC CHAMBERS AND FEED CONNECTORS UTILIZING THE CULTEC MANIFOLD FEATURE. IT MAY ALSO BE USED AS A COMPONENT OF THE CULTEC SEPARATOR ROW TO ACT AS A BARRIER TO PREVENT SOIL/CONTAMINANT INTRUSION INTO THE STONE WHILE ALLOWING FOR MAINTENANCE.
- GEOTEXTILE PARAMETERS**
- THE GEOTEXTILE SHALL BE PROVIDED BY CULTEC OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
 - THE GEOTEXTILE SHALL BE BLACK IN APPEARANCE.
 - THE GEOTEXTILE SHALL HAVE A TENSILE STRENGTH OF 320 X 320 LBS (1,420 X 1,420 N) PER ASTM D4632 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE AN ELONGATION @ BREAK RESISTANCE OF 15 X 15% PER ASTM D4632 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A WIDE WIDTH TENSILE RESISTANCE OF 3,563 X 3,563 LBS/FT (52 X 52 KN/M) PER ASTM D4595 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A CBR PUNCTURE RESISTANCE OF 1,500 LBS (6,670 N) PER ASTM D6241 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A TRAPEZOIDAL TEAR RESISTANCE OF 120 X 120 LBS (540 X 540 N) PER ASTM D4533 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE AN APPARENT OPENING SIZE OF 30 US STD. SIEVE (0.60 MM) PER ASTM D4751 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A PERMITTIVITY RATING OF 0.2 SEC-1 PER ASTM D4491 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A WATER FLOW RATING OF 22 GPM/FT² (900 LPM/M²) PER ASTM D4491 TESTING METHOD.
 - THE GEOTEXTILE SHALL HAVE A UV RESISTANCE OF 70% @ 500 HRS. PER ASTM D4355 TESTING METHOD.

GENERAL NOTES


PIPE	A	B
6" [150 mm]	26.50" [673 mm]	1.00" [25 mm]
8" [200 mm]	24.50" [622 mm]	1.00" [25 mm]
10" [250 mm]	22.25" [565 mm]	1.25" [32 mm]
12" [300 mm]	19.75" [502 mm]	1.75" [45 mm]
15" [375 mm]	16.50" [419 mm]	2.00" [50 mm]
18" [450 mm]	13.00" [330 mm]	2.50" [64 mm]
21" [525 mm]	10.00" [254 mm]	2.50" [64 mm]
24" [600 mm]	7.00" [178 mm]	2.50" [64 mm]
30" [750 mm]	N/A	3.50" [89 mm]

*THE TYPICAL INVERT TABLE ABOVE IS BASED ON THE INSIDE DIAMETER OF STANDARD CORRUGATED PLASTIC PIPE. THE HEAVY DUTY END CAP HAS PRE-MARKED TRIM LINES FOR PIPE DIAMETERS 12" (300mm), 15" (375mm), 18" (450mm) AND 24" (600mm). PIPES OF ANY SIZE AND MATERIAL UP TO 24" (600mm) MAY BE PLACED AT CUSTOM LOCATIONS AND CUSTOM INVERTS. 30" (750 mm) SMOOTH-WALL SDR-35 PVC PIPE MAY BE USED AT THE BOTTOM OF THE END CAP. THE CROWN OF THE PIPE MUST REMAIN A MINIMUM OF 3" (75mm) FROM THE EDGE OF THE HEAVY DUTY END CAP.


FINAL ASSEMBLY

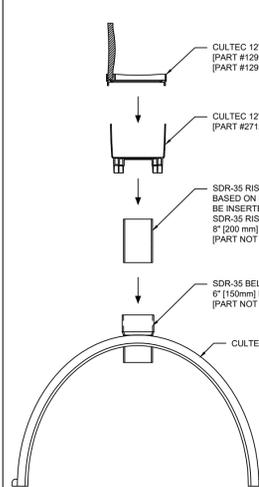


SOLID COVER OPTION




SLOTTED COVER OPTION




PVC BODY PLAN VIEW



PVC BODY ELEVATION VIEW




CULTEC UNIVERSAL INSPECTION PORT KIT DETAIL

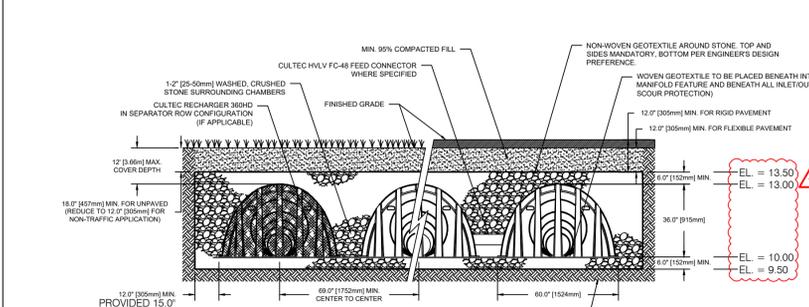

- NOTES**
- THE CHAMBERS SHALL BE DESIGNED AND TESTED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS". THE LOAD CONFIGURATION SHALL INCLUDE:
 - INSTANTANEOUS AASHTO DESIGN TRUCK LIVE LOAD AT MINIMUM COVER
 - MAXIMUM PERMANENT (50-YEAR) COVER LOAD
 - 1-WEEK PARKED AASHTO DESIGN TRUCK LOAD
 - THE CHAMBERS SHALL MEET THE REQUIREMENTS OF ASTM F3430-20 "STANDARD SPECIFICATION FOR CELLULAR POLYPROPYLENE (PP) CORRUGATED WALL STORMWATER COLLECTION CHAMBERS".
 - THE INSTALLED CHAMBER SYSTEM SHALL PROVIDE RESISTANCE TO THE LOADS AND LOAD FACTORS AS DEFINED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS SECTION 12.12. WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS, THE STRUCTURAL DESIGN OF THE CHAMBERS SHALL INCLUDE THE FOLLOWING:
 - THE CREEP MODULUS SHALL BE 50-YEAR AS SPECIFIED IN ASTM F3430
 - THE MINIMUM SAFETY FACTOR FOR LIVE LOADS SHALL BE 1.75
 - THE MINIMUM SAFETY FACTOR FOR DEAD LOADS SHALL BE 1.95


CULTEC RECHARGER 360HD CROSS SECTION

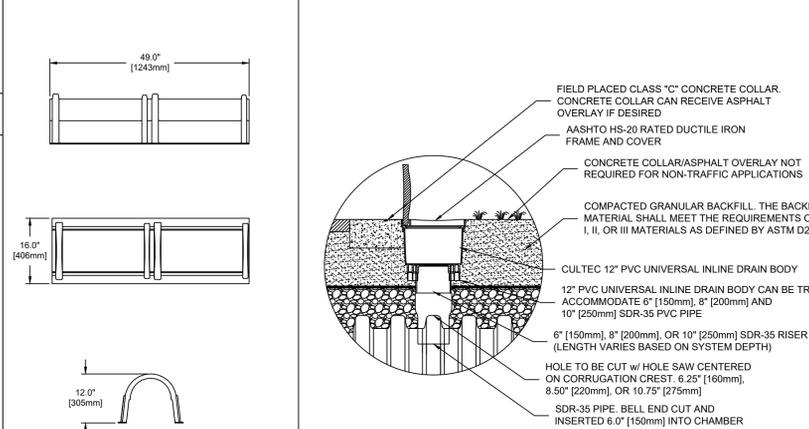


CULTEC HVLV FC-48 FEED CONNECTOR THREE VIEW




OPTIONAL CULTEC INSPECTION PORT - ZOOM DETAIL




CULTEC RECHARGER 360HD HEAVY DUTY THREE VIEW

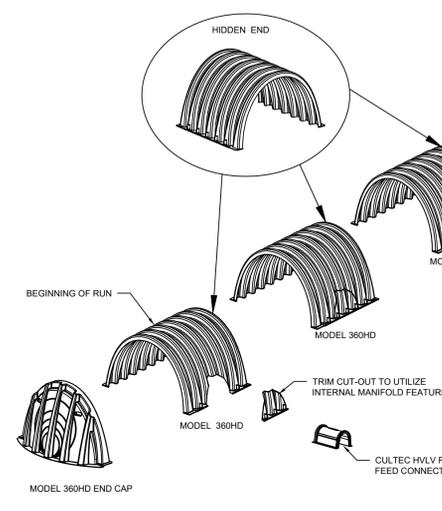


CULTEC RECHARGER 360HD HEAVY DUTY TYPICAL INTERLOCK

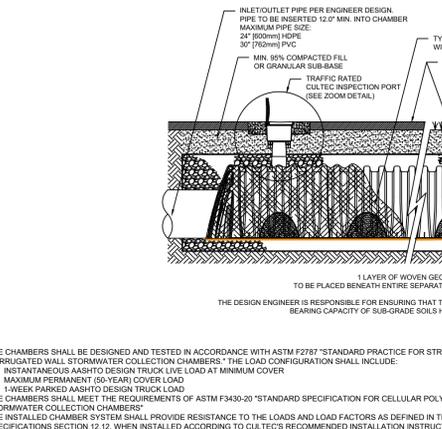

CULTEC SEPARATOR ROW - CULTEC INSPECTION PORT DETAIL (IF APPLICABLE)




CULTEC RECHARGER 360HD CHAMBER STORAGE

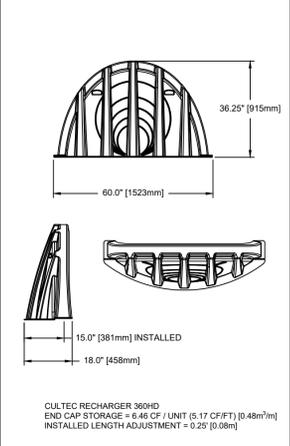

CULTEC RECHARGER 360HD CHAMBER STORAGE = 10.00 CF/FT (0.95 m³/m)
 INSTALLED LENGTH ADJUSTMENT = 0.50" (0.15m)

CULTEC RECHARGER 360HD HEAVY DUTY END CAP THREE VIEW

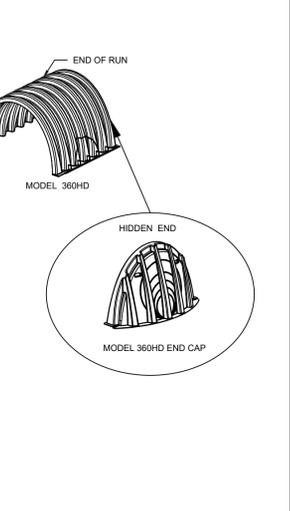

NEI
Narragansett Engineering Inc.
 Civil - Survey Structural Environmental Design
 3102 East Main Road, Portsmouth RI 02871
 Tel. 401.683.6630 www.nei-cds.com

SHEET TITLE

DETAILS AND NOTES

DERBY ACADEMY 56 BURDITT AVE, HINGHAM, MA 02043
 PROPERTY RECORD
 56 BURDITT AVENUE
 HINGHAM, MA 02043
 [PLAT-49 LOT.57, ZONE: RA, AREA: 21.6 ACRES]
 N/F: TRUSTEES OF DERBY ACADEMY

C/O JASON EARLS
 SAGAMORE
 75 RESEARCH RD
 HINGHAM, MA 02043
 T: (781) 531-9466
 E: JEARLS@SAGAMORE.COM

PROJECT NO.	DATE	BY
25.0126	9/16/25	AS

- DRAWING ISSUE:**
- CONCEPT / DISCUSSION
 - PERMITTING
 - CONSTRUCTION
 - AS-BUILT
 - OTHER
- ONLY PLANS ISSUED FOR CONSTRUCTION SHALL BE USED FOR CONSTRUCTION

SCOPE:
 RETAINING WALL DESIGN TO ACCOMMODATE MECH AIR HANDLER
 SITE GRADING/UTILITY RECONFIGURATION LIMIT OF DISTURBANCE, SECC AND RELATED SITE CIVIL WORK



FORMAL PLAN REVISIONS

No	DATE	STAGE/DESCRIPTION	BY
1	12/22/25	RESPONSE TO PEER REVIEW COMMENTS	EB

INTERNAL REVIEW

No	CHECK	CAD	DESCRIPTION/NOTES
1	JM	EB	PRELIMINARY STORMWATER DESIGN, SURFACE GRADES AROUND SYSTEM
2	JM	EB	REVISION OF STORMWATER AND GRADING BASED ON REVISED TOP OF COASTAL BANK AND BUFFER ZONES
3	JM	EB	UPDATED LOD AND DETAIL SHEETS, ADDED MITIGATION AREAS

neil-cds.com

DRAWINGS MUST BE PRINTED IN COLOR OR TO BE VALID. THIS NOTE SHOULD BE BLUE. IF THIS NOTE IS NOT BLUE, PLEASE REPRINT IN COLOR OR CONTACT NEI.



SCALE
 N/A

C-202